




HBA #UL924SR1 & #UL924SR2

For Use with LX or CX Relay Panels where Emergency Lighting should be held on during a utility power failure and controlled by panel while normal power is available

- ① Switched by Panel when Normal Power is available. Held ON when Normal Power is not available and Emergency Power is available

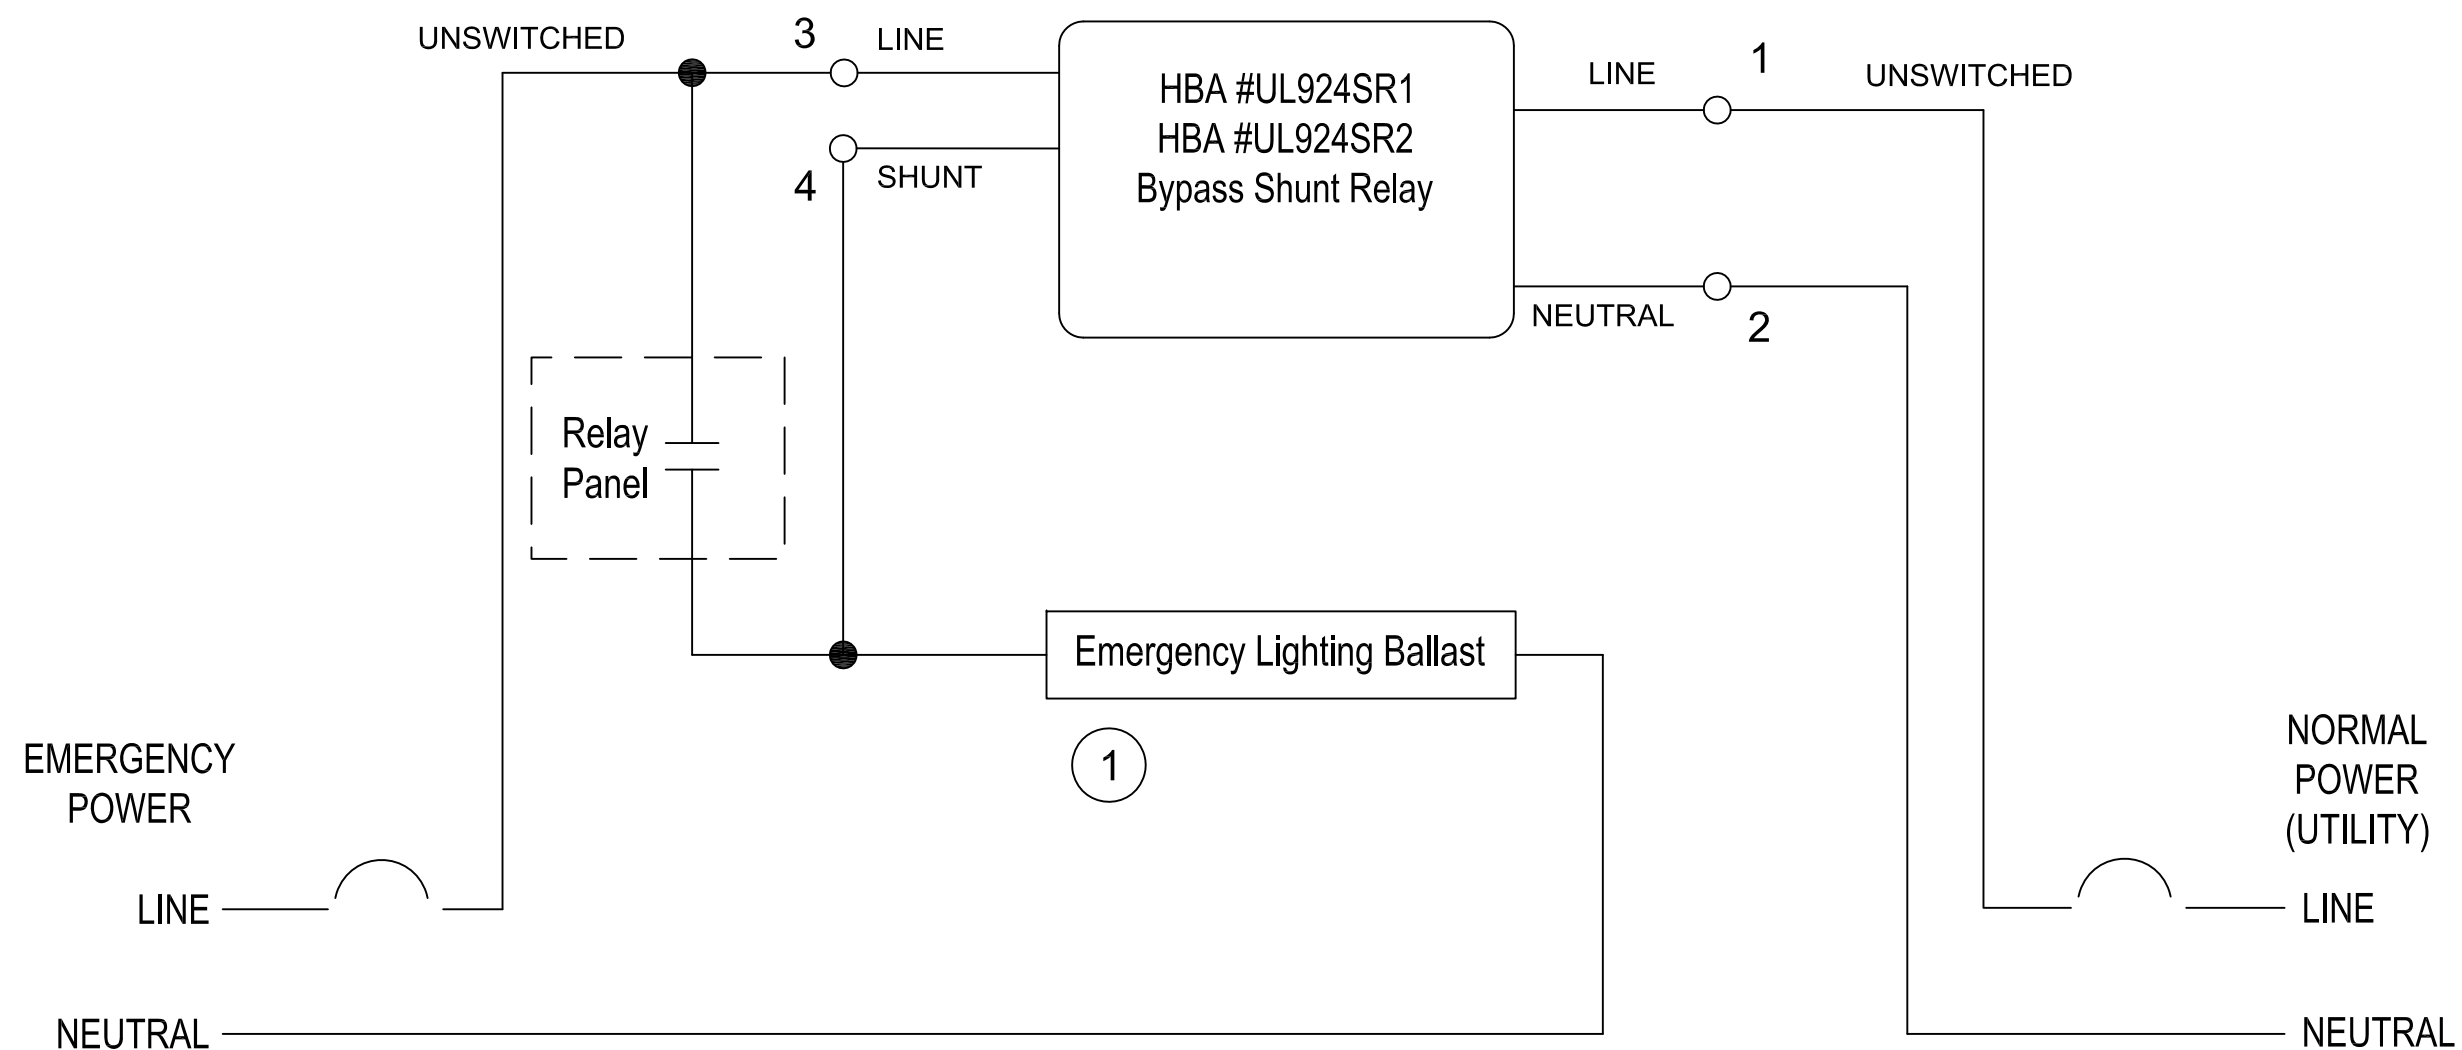

REV	REVISION DESCRIPTION	DATE	LX AND CX PANELS WITH UL924SR1 OR UL924SR2			#UL924SR1 & #UL924SR2
			Hubbell Building Automation (888) 698-3242 9601 Dessau Rd. - Bldg 1 (512) 450-1100 Austin, Tx 78745			ADDRESS STREET CITY, STATE
			THIS DOCUMENT AND SPECIFICATIONS DESCRIBED WITHIN ARE THE EXCLUSIVE PROPERTY OF HUBBELL BUILDING AUTOMATION ISSUED IN THE STRICTEST CONFIDENCE, AND SHALL NOT BE REPRODUCED, COPIED OR USED WITHOUT PRIOR WRITTEN PERMISSION.			STATUS DETAIL DRAWN: AMJ REVIEWED: XXX DATE: 10-22-12
			1			